

Project Information

Reference

Date 14 September 2018

Construction Type

Element : Wall - 0 Spec generator copies

Internal surface emissivity : High External surface emissivity : High

	Thickness (mm)	Thermal Conductivity (W/mK)	Thermal Resistance (m ² K/W)	Pitch (°)	Bridge details Air gaps (Level, Delta U")
Outside surface resistance	-	-	0.130		
Render, lime-sand	7.0	0.800	0.009		
Diffutherm	80.0	0.048	1.650		L:0 0.000W/m ² K
Beltermo Kombi	200.0	0.038	5.250		L:0 0.000W/m ² K
Ampatex Solero	-	-	-		
Timber (500 kg/m ³)	140.0	0.130	1.077		
Inside surface resistance	-	-	0.130		
Total thickness	427.0mm				

U-value = 0.13W/m²K

U-value, Combined Method : 0.127W/m²K (upper/lower limit 8.246 / 8.246m²K/W, dUf 0.0058, dUg 0.0000, dUp0.0000, dUr0.0000, dUrc1 0.0000, dUrc2 0.0000)

Correction factors

Mechanical fasteners :-

Warm pitched roof - insulation over rafters

Alpha : 0.80 per m lambda f : 17.0000W/mK nf : 9.000 per m² Af : 28.000mm² Recess : 20.0mm

Delta Uf for Diffutherm : 0.0007

Warm pitched roof - insulation over rafters

Alpha : 0.80 per m lambda f : 17.0000W/mK nf : 9.000 per m² Af : 28.000mm² Recess : 20.0mm

Delta Uf for Beltermo Kombi : 0.0051

nf = fasteners per m² Af = fasteners cross-sectional area

Air gaps, Delta Ug = 0.000W/m²K

	Thickness (mm)	Thermal Conductivity (W/mK)	Thermal Resistance (m ² K/W)	Vapour Resistivity (MNs/gm)	Vapour Resistance (MNs/g)
Outside surface resistance	-	-	0.130	-	-
Render, lime-sand	7.0	0.800	0.009	50.00	0.35
Diffutherm	80.0	0.048	1.650	25.00	2.00
Beltermo Kombi	200.0	0.038	5.250	15.00	3.00
Ampatex Solero	-	-	-	-	25.00
Timber (500 kg/m ³)	140.0	0.130	1.077	250.00	35.00
Inside surface resistance	-	-	0.130	-	-
Total thickness	427.0mm				

Structure element : Wall
Condensation calculations performed in accordance with BS5250:2011

Condensation is occurring at the following layers interfaces:-

Month	Int (C°)	Int (%RH)	Ext (C°)	Ext (%RH)
Jan	21.00	54.70	3.50	86.00
Feb	21.00	53.80	3.80	82.50
Mar	21.00	53.90	5.70	80.00
Apr	21.00	54.40	8.00	77.00
May	21.00	57.90	11.30	77.00
Jun	21.00	62.20	14.40	76.00
Jul	21.00	66.80	16.50	76.50
Aug	21.00	67.40	16.10	78.50
Sep	21.00	64.60	13.80	81.50
Oct	21.00	60.80	10.70	84.00
Nov	21.00	56.50	6.40	85.50
Dec	21.00	55.50	4.50	86.50

Gc = Monthly moisture accumulation per area at an interface

Ma = Accumulated moisture content per area at an interface

Peak accumulated moisture content per area at interface (Ma) = 0.00000 Kg/m²

Annual moisture accumulation = 0.00000 Kg/m²

Project Information

Reference

Date 14 September 2018

Thermal Mass Details

	Thickness assessed (actual) (mm)	Density (kg/m ³)	Specific heat capacity (J/kgK)	Heat capacity (kJ/m ² K)
Render, lime-sand	0.0 (7.0)	1600.0	1000.0	0.0
Diffutherm	0.0 (80.0)	190.0	2100.0	0.0
Beltermo Kombi	0.0 (200.0)	110.0	2100.0	0.0
Ampatex Solero	0.0 (-)	280.0	850.0	0.0
Timber (500 kg/m ³)	100.0 (140.0)	500.0	1600.0	80000000.0
Total				80000000.0
kappa value				80.0000
Limiting condition:	100mm in			

Admittance : 2.16 W/m²K Decrement : 0.03 factor Decrement delay : -23.21 hours


Condensation Risk Analysis (no account taken of thermal bridges)

3 - Dwellings with low occupancy

Jan (worst)	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
21.0C 54.7%	21.0C 53.8%	21.0C 53.9%	21.0C 54.4%	21.0C 57.9%	21.0C 62.2%	21.0C 66.8%	21.0C 67.4%	21.0C 64.6%	21.0C 60.8%	21.0C 56.5%	21.0C 55.5%
3.5C 86.0%	3.8C 82.5%	5.7C 80.0%	8.0C 77.0%	11.3C 77.0%	14.4C 76.0%	16.5C 76.5%	16.1C 78.5%	13.8C 81.5%	10.7C 84.0%	6.4C 85.5%	4.5C 86.5%

	Interface Temp. °C	Dewpoint Temp. °C	Vapour Pressure (kPa)	Saturated V.P. (kPa)	Worst Cond. (g/m ²)	Peak Buildup (g/m ²)	Condensation
1 Outside surface resistance							
2 Render, lime-sand	3.8	1.4	0.67	0.80			No
3 Diffutherm	3.8	1.5	0.68	0.80			No
4 Beltermo Kombi	7.3	1.9	0.70	1.02			No
5 Ampatex Solero	18.5	2.5	0.73	2.13			No
6 Timber (500 kg/m ³)	18.5	6.9	0.99	2.13			No
7 Inside surface resistance	20.8	11.5	1.36	2.45			No

Worst case internal / external conditions for graph : 21.0°C @ 54.7%RH / 3.5°C @ 86.0%RH

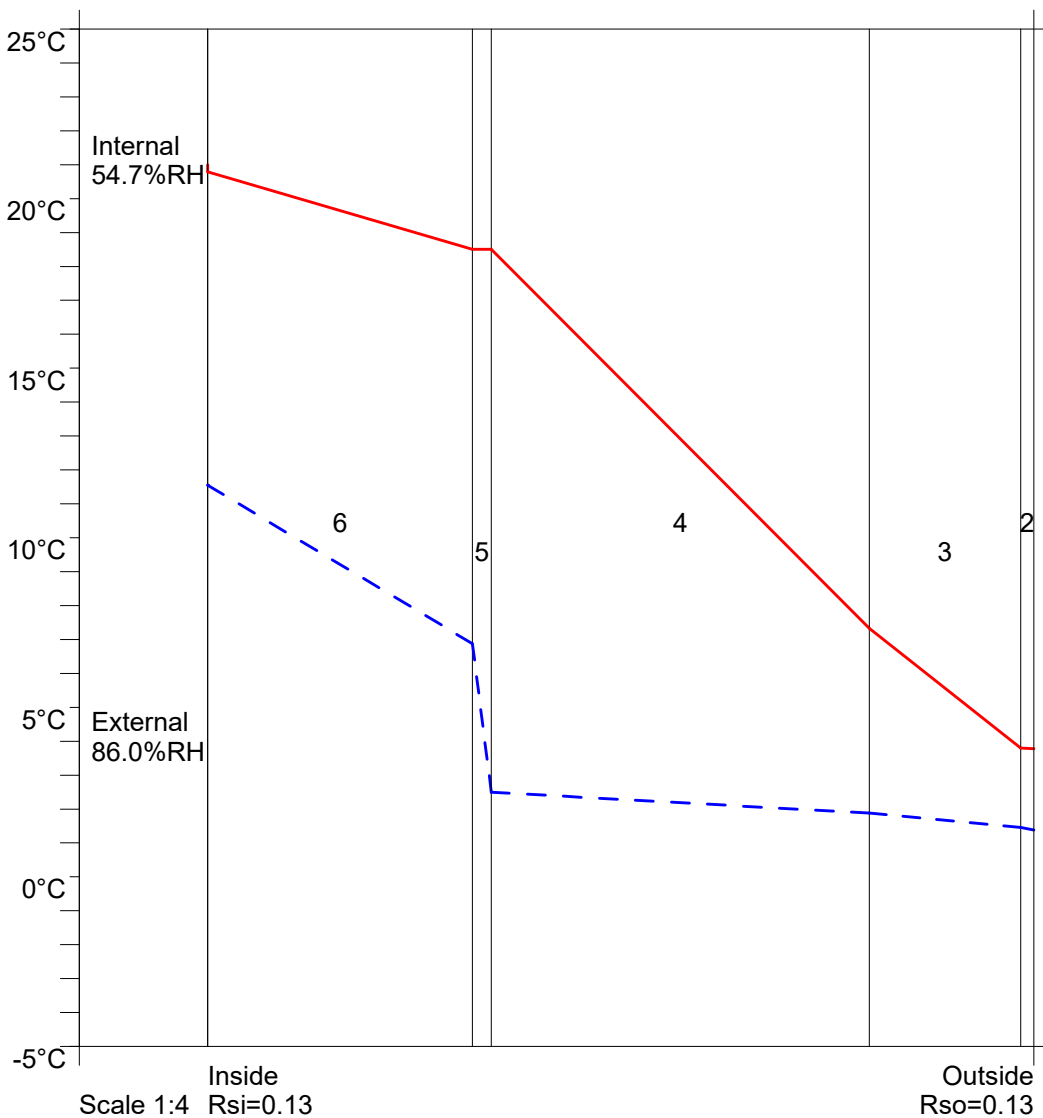

Condensation Risk Analysis (no account taken of thermal bridges)

3 - Dwellings with low occupancy

Jan (worst)	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
21.0C 54.7%	21.0C 53.8%	21.0C 53.9%	21.0C 54.4%	21.0C 57.9%	21.0C 62.2%	21.0C 66.8%	21.0C 67.4%	21.0C 64.6%	21.0C 60.8%	21.0C 56.5%	21.0C 55.5%
3.5C 86.0%	3.8C 82.5%	5.7C 80.0%	8.0C 77.0%	11.3C 77.0%	14.4C 76.0%	16.5C 76.5%	16.1C 78.5%	13.8C 81.5%	10.7C 84.0%	6.4C 85.5%	4.5C 86.5%

	Interface Temp. °C	Dewpoint Temp. °C	Vapour Pressure (kPa)	Saturated V.P. (kPa)	Worst Cond. (g/m ²)	Peak Buildup (g/m ²)	Conden-sation
1 Outside surface resistance							
2 Render, lime-sand	16.6	12.4	1.44	1.88			No
3 Diffutherm	16.6	12.4	1.44	1.89			No
4 Beltermo Kombi	17.5	12.5	1.44	2.00			No
5 Ampatex Solero	20.4	12.6	1.45	2.39			No
6 Timber (500 kg/m ³)	20.4	13.4	1.54	2.39			No
7 Inside surface resistance	20.9	14.6	1.66	2.48			No

Worst case internal / external conditions for graph : 21.0°C @ 66.8%RH / 16.5°C @ 76.5%RH

