

Back to Earth SW Ltd

7 Tuns Lane
Silverton
Exeter
EX5 4HY

Project Information

Reference

Date 17 November 2023

Construction Type

Element : Pitched roof, ceiling at rafter line - Roof-pitched-over- 200mm

Internal surface emissivity : High External surface emissivity : High

| | Thickness (mm) | Thermal Conductivity (W/mK) | Thermal Resistance (m ² K/W) | Pitch (°) | Bridge details Air gaps (Level, Delta U") |
|--|-------------------|-----------------------------------|---|--------------|---|
| Outside surface resistance | - | - | 0.040 | | |
| Ampatop Protecta | - | - | - | | |
| Beltermo Ultra | 80.0 | 0.042 | 1.900 | | L:0 0.000W/m ² K |
| UdiTHERM | 80.0 | 0.038 | 2.100 | | L:0 0.000W/m ² K |
| SteicoFlex | 200.0 | 0.036 | 5.550 | | 9.000% Softwood (200.0mm) L:0 0.000W/m ² K |
| Oriented strandboard (OSB) | 9.0 | 0.130 | 0.069 | | |
| Ampatex Sinco | - | - | - | | |
| Airspace, heat flow upwards, 25 mm thick | 25.0 | - | 0.160 | | 11.800% Softwood (25.0mm) |
| Gyproc Wallboard | 12.5 | 0.190 | 0.066 | | |
| Inside surface resistance | - | - | 0.100 | | |
| Total thickness | 406.5mm | | | | |

U-value = 0.11W/m²K

U-value, Combined Method : 0.115W/m²K (upper/lower limit 9.420 / 8.934m²K/W, dUf 0.0057, dUg 0.0000, dUp0.0000, dUr0.0000, dUrc1 0.0000, dUrc2 0.0000)

Correction factors

Mechanical fasteners :-

Warm pitched roof - insulation over rafters

Alpha : 0.80 per m lambda f : 50.0000W/mK nf : 6.700 per m² Af : 12.500mm² Recess : 0.0mm

Delta Uf for Beltermo Ultra : 0.0015

Warm pitched roof - insulation over rafters

Alpha : 0.80 per m lambda f : 50.0000W/mK nf : 6.700 per m² Af : 28.500mm² Recess : 0.0mm

Delta Uf for UdiTHERM : 0.0042

nf = fasteners per m² Af = fasteners cross-sectional area

Air gaps, Delta Ug = 0.000W/m²K

(Based on the combined method for determining U-values of structures containing repeating thermal bridges)

| | Thickness (mm) | Thermal Conductivity (W/mK) | Thermal Resistance (m ² K/W) | Vapour Resistivity (MNs/gm) | Vapour Resistance (MNs/g) |
|--|-------------------|-----------------------------------|---|-----------------------------------|---------------------------------|
| Outside surface resistance | - | - | 0.040 | - | - |
| Ampatop Protecta | - | - | - | - | 0.50 |
| Beltermo Ultra | 80.0 | 0.042 | 1.900 | 15.00 | 1.20 |
| UdiTHERM | 80.0 | 0.038 | 2.100 | 25.00 | 2.00 |
| SteicoFlex | 200.0 | 0.036 | 5.550 | 5.00 | 1.00 |
| Oriented strandboard (OSB) | 9.0 | 0.130 | 0.069 | 250.00 | 2.25 |
| Ampatex Sinco | - | - | - | - | 25.00 |
| Airspace, heat flow upwards, 25 mm thick | 25.0 | - | 0.160 | - | 0.00 |
| Gyproc Wallboard | 12.5 | 0.190 | 0.066 | 50.00 | 0.63 |
| Inside surface resistance | - | - | 0.100 | - | - |
| Total thickness | 406.5mm | | | | |

Detailed U-value Calculation Results

Construction includes 2 bridged layers

Non-bridged layers

| | |
|---|-------------------------------|
| Outside surface resistance | 0.040 m ² K/W |
| Beltermo Ultra | 1.900 m ² K/W |
| UdiTHERM | 2.100 m ² K/W |
| Oriented strandboard (OSB) | 0.069 m ² K/W |
| Gyproc Wallboard | 0.066 m ² K/W |
| Inside surface resistance | 0.100 m ² K/W |
| Resistance of non-bridged layers, R _{NB} = | <u>4.275 m²K/W</u> |

Bridged layers

SteicoFlex (L1) bridged by Softwood (B1)

Airspace, heat flow upwards, 25 mm thick (L2) bridged by Softwood (B2)

Path 1 - SteicoFlex

Path 2 - Softwood /

Path 3 - SteicoFlex

Path 4 - Softwood /

Resistance and fraction of heat flow paths

$$R_{P1} = R_{NB} + R_{L1} = 4.275 + 5.710 = 9.985 \text{ m}^2\text{K/W} \quad F_{P1} = 80.262\%$$

$$R_{P2} = R_{NB} + R_{L2} = 4.275 + 1.698 = 5.974 \text{ m}^2\text{K/W} \quad F_{P2} = 7.938\%$$

$$R_{P3} = R_{NB} + R_{L3} = 4.275 + 5.742 = 10.018 \text{ m}^2\text{K/W} \quad F_{P3} = 10.738\%$$

$$R_{P4} = R_{NB} + R_{L4} = 4.275 + 1.731 = 6.006 \text{ m}^2\text{K/W} \quad F_{P4} = 1.062\%$$

Upper resistance limit

$$R_{\text{upper}} = 1 / \left(\frac{F_{P1}}{R_{P1}} + \frac{F_{P2}}{R_{P2}} + \frac{F_{P3}}{R_{P3}} + \frac{F_{P4}}{R_{P4}} \right)$$

$$R_{\text{upper}} = 1 / \left(\frac{0.803}{9.985} + \frac{0.079}{5.974} + \frac{0.107}{10.018} + \frac{0.011}{6.006} \right) = 9.420 \text{ m}^2\text{K/W}$$

Lower resistance limit

$$R_{\text{lower}} = R_{NB} + 1 / \left(\frac{F_{L1}}{R_{L1}} + \frac{F_{B1}}{R_{B1}} \right) + 1 / \left(\frac{F_{L2}}{R_{L2}} + \frac{F_{B2}}{R_{B2}} \right)$$

$$R_{\text{lower}} = 4.275 + 1 / \left(\frac{0.910}{5.550} + \frac{0.090}{1.538} \right) + 1 / \left(\frac{0.882}{0.160} + \frac{0.118}{0.192} \right) = 8.934 \text{ m}^2\text{K/W}$$

Total resistance of roof

$$R_T = (R_{\text{upper}} + R_{\text{lower}}) / 2 = (9.420 + 8.934) / 2 = 9.18 \text{ m}^2\text{K/W}$$

Mechanical fasteners :-

Calculations to BS EN ISO 6946:2007

Warm pitched roof - insulation over rafters

Alpha : 0.80 per m lambda f : 50.0000W/mK nf : 6.700 per m² Af : 12.500mm² Recess : 0.0mm

Delta Uf for Beltermo Ultra : 0.0015

Warm pitched roof - insulation over rafters

Alpha : 0.80 per m lambda f : 50.0000W/mK nf : 6.700 per m² Af : 28.500mm² Recess : 0.0mm

Delta Uf for UdiTHERM : 0.0042

Correction for air gaps, Delta Ug = 0.0000W/m²K

$$U = (1 / R_T) + (\Delta U_f + \Delta U_g + \Delta U_p + \Delta U_{rc2} + \Delta U_{rc2}) = (1/9.1768) + 0.0057 + 0.0000 + 0.0000 + 0.0000 + 0.0000 = 0.11 \text{ W/m}^2\text{K}$$

Structure element : Pitched roof, ceiling at rafter line
Condensation calculations performed in accordance with BS5250:2021

Condensation is occurring at the following layers interfaces:-

| Month | Int (C°) | Int (%RH) | Ext (C°) | Ext (%RH) |
|-------|-------------|--------------|-------------|--------------|
| Jan | 21.00 | 45.10 | 3.10 | 85.00 |
| Feb | 21.00 | 44.60 | 3.10 | 83.50 |
| Mar | 21.00 | 45.40 | 5.20 | 79.50 |
| Apr | 21.00 | 46.70 | 7.60 | 75.50 |
| May | 21.00 | 51.40 | 10.60 | 76.00 |
| Jun | 21.00 | 57.20 | 14.00 | 74.50 |
| Jul | 21.00 | 61.90 | 15.80 | 75.00 |
| Aug | 21.00 | 62.60 | 15.40 | 77.50 |
| Sep | 21.00 | 58.60 | 13.20 | 79.50 |
| Oct | 21.00 | 53.90 | 10.00 | 83.00 |
| Nov | 21.00 | 48.00 | 6.00 | 84.00 |
| Dec | 21.00 | 46.40 | 4.20 | 85.50 |

Gc = Monthly moisture accumulation per area at an interface

Ma = Accumulated moisture content per area at an interface

Peak accumulated moisture content per area at interface (Ma) = 0.00000 Kg/m²

Annual moisture accumulation = 0.00000 Kg/m²

Project Information

Reference

Date 17 November 2023

Thermal Mass Details

| | Thickness assessed (actual) (mm) | Density (kg/m ³) | Specific heat capacity (J/kgK) | Heat capacity (kJ/m ² K) |
|--|--|---------------------------------|--------------------------------------|---|
| Ampatop Protecta | 0.0 (-) | 300.0 | 850.0 | 0.0 |
| Beltermo Ultra | 0.0 (80.0) | 180.0 | 2100.0 | 0.0 |
| UdiTHERM | 0.0 (80.0) | 140.0 | 2100.0 | 0.0 |
| SteicoFlex | 0.0 (200.0) | 60.0 | 2100.0 | 0.0 |
| Oriented strandboard (OSB) | 9.0 (9.0) | 650.0 | 1700.0 | 9945000.0 |
| Ampatex Sinco | 0.0 (-) | 280.0 | 850.0 | 0.0 |
| Airspace, heat flow upwards, 25 mm thick | 25.0 (25.0) | 1.2 | 1008.0 | 30240.0 |
| Gyproc Wallboard | 12.5 (12.5) | 0.0 | 0.0 | 0.0 |
| Total | | | | 9975240.0 |
| kappa value | | | | 9.9752 |
| Limiting condition: | insulation | | | |

Admittance : 1.02 W/m²K Decrement : 0.08 factor Decrement delay : -17.52 hours


Condensation Risk Analysis (no account taken of thermal bridges)

2 - Offices, shops and dwellings with low occupancy

| Jan (worst) | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| 21.0C 45.1% | 21.0C 44.6% | 21.0C 45.4% | 21.0C 46.7% | 21.0C 51.4% | 21.0C 57.2% | 21.0C 61.9% | 21.0C 62.6% | 21.0C 58.6% | 21.0C 53.9% | 21.0C 48.0% | 21.0C 46.4% |
| 3.1C 85.0% | 3.1C 83.5% | 5.2C 79.5% | 7.6C 75.5% | 10.6C 76.0% | 14.0C 74.5% | 15.8C 75.0% | 15.4C 77.5% | 13.2C 79.5% | 10.0C 83.0% | 6.0C 84.0% | 4.2C 85.5% |

| | Interface Temp. °C | Dewpoint Temp. °C | Vapour Pressure (kPa) | Saturated V.P. (kPa) | Worst Cond. (g/m ²) | Peak Buildup (g/m ²) | Condensation |
|--|--------------------|-------------------|-----------------------|----------------------|---------------------------------|----------------------------------|--------------|
| 1 Outside surface resistance | | | | | | | |
| 2 Ampatop Protecta | 3.2 | 0.8 | 0.65 | 0.77 | | | No |
| 3 Beltermo Ultra | 3.2 | 1.0 | 0.66 | 0.77 | | | No |
| 4 UdiTHERM | 6.6 | 1.3 | 0.67 | 0.97 | | | No |
| 5 SteicoFlex | 10.4 | 1.9 | 0.70 | 1.26 | | | No |
| 6 Oriented strandboard (OSB) | 20.3 | 2.2 | 0.72 | 2.38 | | | No |
| 7 Ampatex Sinco | 20.4 | 2.8 | 0.75 | 2.40 | | | No |
| 8 Airspace, heat flow upwards, 25 mm thick | 20.4 | 8.5 | 1.11 | 2.40 | | | No |
| 9 Gyproc Wallboard | 20.7 | 8.5 | 1.11 | 2.44 | | | No |
| 10 Inside surface resistance | 20.8 | 8.7 | 1.12 | 2.46 | | | No |

Worst case internal / external conditions for graph : 21.0°C @ 45.1%RH / 3.1°C @ 85.0%RH

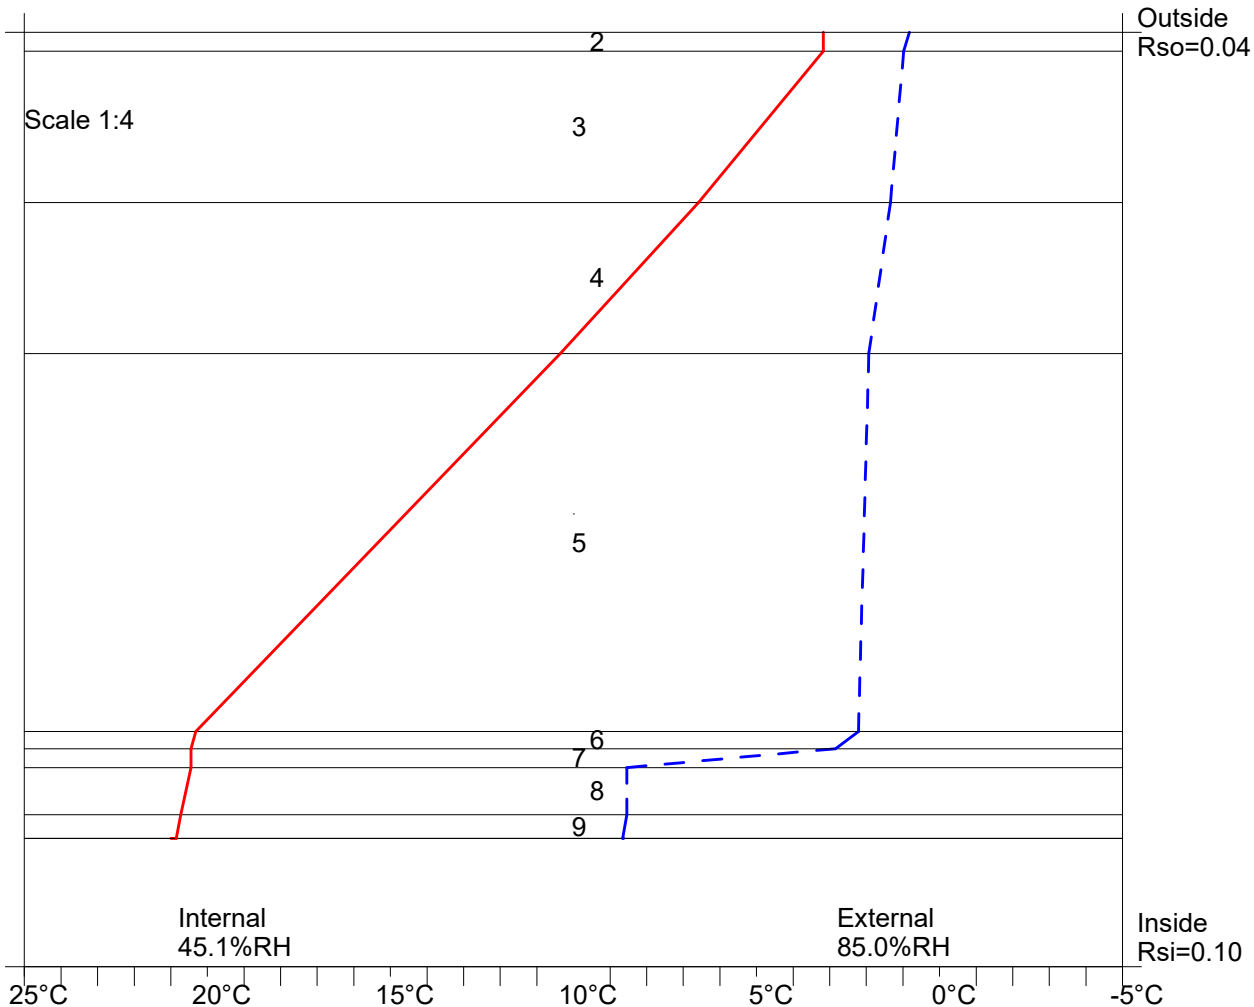

Condensation Risk Analysis (no account taken of thermal bridges)

2 - Offices, shops and dwellings with low occupancy

| Jan (worst) | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| 21.0C 45.1% | 21.0C 44.6% | 21.0C 45.4% | 21.0C 46.7% | 21.0C 51.4% | 21.0C 57.2% | 21.0C 61.9% | 21.0C 62.6% | 21.0C 58.6% | 21.0C 53.9% | 21.0C 48.0% | 21.0C 46.4% |
| 3.1C 85.0% | 3.1C 83.5% | 5.2C 79.5% | 7.6C 75.5% | 10.6C 76.0% | 14.0C 74.5% | 15.8C 75.0% | 15.4C 77.5% | 13.2C 79.5% | 10.0C 83.0% | 6.0C 84.0% | 4.2C 85.5% |

| | Interface Temp. °C | Dewpoint Temp. °C | Vapour Pressure (kPa) | Saturated V.P. (kPa) | Worst Cond. (g/m ²) | Peak Buildup (g/m ²) | Condensation |
|--|--------------------|-------------------|-----------------------|----------------------|---------------------------------|----------------------------------|--------------|
| 1 Outside surface resistance | | | | | | | |
| 2 Ampatop Protecta | 15.8 | 11.4 | 1.35 | 1.80 | | | No |
| 3 Beltermo Ultra | 15.8 | 11.4 | 1.35 | 1.80 | | | No |
| 4 UdiTHERM | 16.8 | 11.5 | 1.36 | 1.91 | | | No |
| 5 SteicoFlex | 17.9 | 11.6 | 1.37 | 2.05 | | | No |
| 6 Oriented strandboard (OSB) | 20.8 | 11.7 | 1.37 | 2.46 | | | No |
| 7 Ampatex Sinco | 20.8 | 11.8 | 1.39 | 2.46 | | | No |
| 8 Airspace, heat flow upwards, 25 mm thick | 20.8 | 13.4 | 1.53 | 2.46 | | | No |
| 9 Gyproc Wallboard | 20.9 | 13.4 | 1.53 | 2.47 | | | No |
| 10 Inside surface resistance | 21.0 | 13.4 | 1.54 | 2.48 | | | No |

Worst case internal / external conditions for graph : 21.0°C @ 61.9%RH / 15.8°C @ 75.0%RH

