

Back to Earth SW Ltd

7 Tuns Lane
Silverton
Exeter
EX5 4HY

Project Information

Reference

Date 4 December 2023

Construction Type

Element : Wall - Wall-masonry-cavity-external-render

Internal surface emissivity : High External surface emissivity : High

	Thickness (mm)	Thermal Conductivity (W/mK)	Thermal Resistance (m ² K/W)	Pitch (°)	Bridge details Air gaps (Level, Delta U")
Outside surface resistance	-	-	0.040		
Baumit RK70N	5.0	0.900	0.006		
Beltermo Ultra	120.0	0.042	2.850		L:0 0.000W/m ² K
Baumit RK38/39	18.0	0.900	0.020		
Brick outer leaf	105.0	0.770	0.136		
Supafil 40	50.0	0.040	1.250		L:0 0.000W/m ² K
Brick inner leaf	105.0	0.560	0.188		
Render, lime-sand	25.0	0.800	0.031		
Inside surface resistance	-	-	0.130		
Total thickness	428.0mm				

U-value = 0.22W/m²K

U-value, Combined Method : 0.224W/m²K (upper/lower limit 4.651 / 4.651m²K/W, dUf 0.0090, dUg 0.0000, dUp0.0000, dUr0.0000, dUrc1 0.0000, dUrc2 0.0000)

Correction factors

Mechanical fasteners :-

Insulation Fixings

Point thermal transmittance : 0.0010W/K nf : 9.000 per m²

Delta Uf for Beltermo Ultra : 0.0090

nf = fasteners per m² Af = fasteners cross-sectional area

Air gaps, Delta Ug = 0.000W/m²K

	Thickness (mm)	Thermal Conductivity (W/mK)	Thermal Resistance (m ² K/W)	Vapour Resistivity (MNs/gm)	Vapour Resistance (MNs/g)
Outside surface resistance	-	-	0.040	-	-
Baumit RK70N	5.0	0.900	0.006	50.00	0.25
Beltermo Ultra	120.0	0.042	2.850	25.00	3.00
Baumit RK38/39	18.0	0.900	0.020	50.00	0.90
Brick outer leaf	105.0	0.770	0.136	50.00	5.25
Supafil 40	50.0	0.040	1.250	5.00	0.25
Brick inner leaf	105.0	0.560	0.188	50.00	5.25
Render, lime-sand	25.0	0.800	0.031	50.00	1.25
Inside surface resistance	-	-	0.130	-	-
Total thickness	428.0mm				

Structure element : Wall
Condensation calculations performed in accordance with BS5250:2021

Condensation is occurring at the following layers interfaces:-

Month	Int (C°)	Int (%RH)	Ext (C°)	Ext (%RH)
Jan	21.00	45.10	3.10	85.00
Feb	21.00	44.60	3.10	83.50
Mar	21.00	45.40	5.20	79.50
Apr	21.00	46.70	7.60	75.50
May	21.00	51.40	10.60	76.00
Jun	21.00	57.20	14.00	74.50
Jul	21.00	61.90	15.80	75.00
Aug	21.00	62.60	15.40	77.50
Sep	21.00	58.60	13.20	79.50
Oct	21.00	53.90	10.00	83.00
Nov	21.00	48.00	6.00	84.00
Dec	21.00	46.40	4.20	85.50

Gc = Monthly moisture accumulation per area at an interface

Ma = Accumulated moisture content per area at an interface

Peak accumulated moisture content per area at interface (Ma) = 0.00000 Kg/m²

Annual moisture accumulation = 0.00000 Kg/m²

Project Information

Reference

Date 4 December 2023

Thermal Mass Details

	Thickness assessed (actual) (mm)	Density (kg/m ³)	Specific heat capacity (J/kgK)	Heat capacity (kJ/m ² K)
Baunit RK70N	0.0 (5.0)	1300.0	1000.0	0.0
Beltermo Ultra	0.0 (120.0)	180.0	2100.0	0.0
Baunit RK38/39	0.0 (18.0)	1300.0	1000.0	0.0
Brick outer leaf	0.0 (105.0)	1700.0	840.0	0.0
Supafil 40	0.0 (50.0)	0.0	0.0	0.0
Brick inner leaf	75.0 (105.0)	1700.0	840.0	107100000.0
Render, lime-sand	25.0 (25.0)	1600.0	1000.0	40000000.0
Total				147100000.0
kappa value				147.1000
Limiting condition:	100mm in			

Admittance : 4.37 W/m²K Decrement : 0.11 factor Decrement delay : -15.55 hours


Condensation Risk Analysis (no account taken of thermal bridges)

2 - Offices, shops and dwellings with low occupancy

Jan (worst)	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
21.0C 45.1%	21.0C 44.6%	21.0C 45.4%	21.0C 46.7%	21.0C 51.4%	21.0C 57.2%	21.0C 61.9%	21.0C 62.6%	21.0C 58.6%	21.0C 53.9%	21.0C 48.0%	21.0C 46.4%
3.1C 85.0%	3.1C 83.5%	5.2C 79.5%	7.6C 75.5%	10.6C 76.0%	14.0C 74.5%	15.8C 75.0%	15.4C 77.5%	13.2C 79.5%	10.0C 83.0%	6.0C 84.0%	4.2C 85.5%

	Interface Temp. °C	Dewpoint Temp. °C	Vapour Pressure (kPa)	Saturated V.P. (kPa)	Worst Cond. (g/m ²)	Peak Buildup (g/m ²)	Condensation
1 Outside surface resistance							
2 Baunit RK70N	3.3	0.8	0.65	0.77			No
3 Beltermo Ultra	3.3	1.0	0.66	0.77			No
4 Baunit RK38/39	14.3	2.7	0.74	1.63			No
5 Brick outer leaf	14.3	3.2	0.77	1.63			No
6 Supafil 40	14.9	5.8	0.92	1.69			No
7 Brick inner leaf	19.7	5.9	0.93	2.29			No
8 Render, lime-sand	20.4	8.2	1.08	2.40			No
9 Inside surface resistance	20.5	8.7	1.12	2.41			No

Worst case internal / external conditions for graph : 21.0°C @ 45.1%RH / 3.1°C @ 85.0%RH

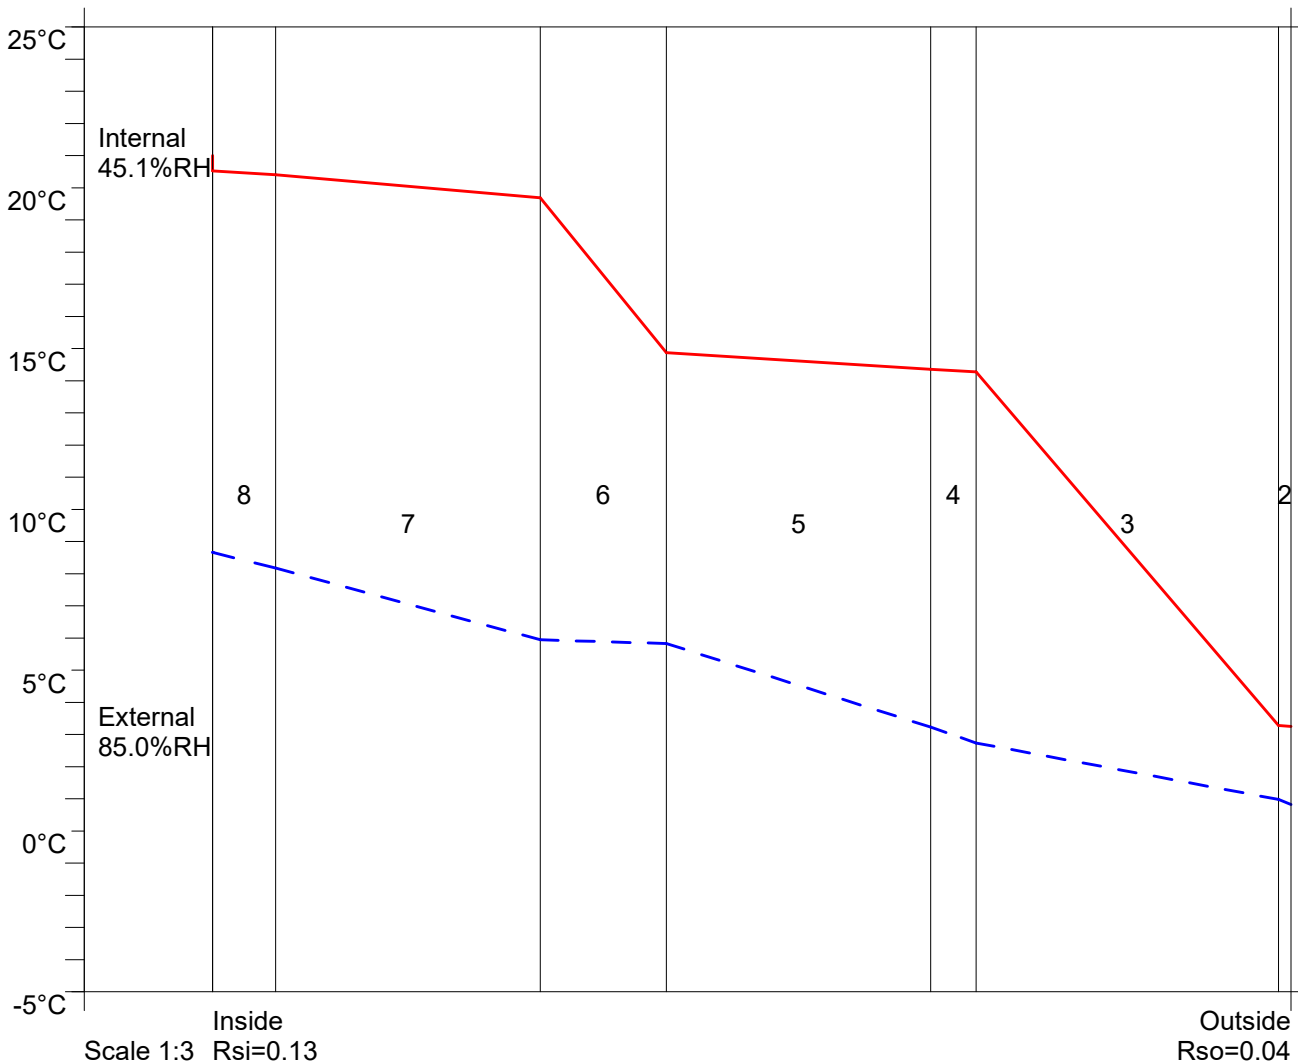

Condensation Risk Analysis (no account taken of thermal bridges)

2 - Offices, shops and dwellings with low occupancy

Jan (worst)	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
21.0C 45.1%	21.0C 44.6%	21.0C 45.4%	21.0C 46.7%	21.0C 51.4%	21.0C 57.2%	21.0C 61.9%	21.0C 62.6%	21.0C 58.6%	21.0C 53.9%	21.0C 48.0%	21.0C 46.4%
3.1C 85.0%	3.1C 83.5%	5.2C 79.5%	7.6C 75.5%	10.6C 76.0%	14.0C 74.5%	15.8C 75.0%	15.4C 77.5%	13.2C 79.5%	10.0C 83.0%	6.0C 84.0%	4.2C 85.5%

	Interface Temp. °C	Dewpoint Temp. °C	Vapour Pressure (kPa)	Saturated V.P. (kPa)	Worst Cond. (g/m ²)	Peak Buildup (g/m ²)	Condensation
1 Outside surface resistance							
2 Baunit RK70N	15.8	11.4	1.35	1.80			No
3 Beltermo Ultra	15.9	11.4	1.35	1.80			No
4 Baunit RK38/39	19.0	11.8	1.38	2.20			No
5 Brick outer leaf	19.1	11.9	1.40	2.21			No
6 Supafil 40	19.2	12.6	1.46	2.23			No
7 Brick inner leaf	20.6	12.6	1.46	2.43			No
8 Render, lime-sand	20.8	13.3	1.52	2.46			No
9 Inside surface resistance	20.9	13.4	1.54	2.46			No

Worst case internal / external conditions for graph : 21.0°C @ 61.9%RH / 15.8°C @ 75.0%RH

