

Back to Earth SW Ltd

7 Tuns Lane
Silverton
Exeter
EX5 4HY

Project Information

Reference

Date 4 December 2023

Construction Type

Element : Wall - Wall-masonry-solid-external-timber clad

Internal surface emissivity : High External surface emissivity : High

	Thickness (mm)	Thermal Conductivity (W/mK)	Thermal Resistance (m ² K/W)	Pitch (°)	Bridge details Air gaps (Level, Delta U")
Outside surface resistance	-	-	0.040		
Ampatop Protecta	-	-	-		
NaturHeld Wall 140	140.0	0.041	3.400		L:0 0.000W/m ² K
Baunit RK38/39	18.0	0.900	0.020		
Brick outer leaf	105.0	0.770	0.136		
Brick inner leaf	105.0	0.560	0.188		
Render, lime-sand	25.0	0.800	0.031		
Inside surface resistance	-	-	0.130		
Total thickness	393.0mm				

U-value = 0.27W/m²K

U-value, Combined Method : 0.269W/m²K (upper/lower limit 3.945 / 3.945m²K/W, dUf 0.0153, dUg 0.0000, dUp0.0000, dUr0.0000, dUrc1 0.0000, dUrc2 0.0000)

Correction factors

Mechanical fasteners :-

Insulation Fixings

Alpha : 0.80 per m lambda f : 50.0000W/mK nf : 6.000 per m² Af : 12.000mm² Recess : 0.0mm

Delta Uf for NaturHeld Wall 140 : 0.0153

nf = fasteners per m² Af = fasteners cross-sectional area

Air gaps, Delta Ug = 0.000W/m²K

	Thickness (mm)	Thermal Conductivity (W/mK)	Thermal Resistance (m ² K/W)	Vapour Resistivity (MNs/gm)	Vapour Resistance (MNs/g)
Outside surface resistance	-	-	0.040	-	-
Ampatop Protecta	-	-	-	-	0.50
NaturHeld Wall 140	140.0	0.041	3.400	25.00	3.50
Baumit RK38/39	18.0	0.900	0.020	50.00	0.90
Brick outer leaf	105.0	0.770	0.136	50.00	5.25
Brick inner leaf	105.0	0.560	0.188	50.00	5.25
Render, lime-sand	25.0	0.800	0.031	50.00	1.25
Inside surface resistance	-	-	0.130	-	-
Total thickness	393.0mm				

Structure element : Wall
Condensation calculations performed in accordance with BS5250:2021

Condensation is occurring at the following layers interfaces:-

Month	Int (C°)	Int (%RH)	Ext (C°)	Ext (%RH)
Jan	21.00	45.10	3.10	85.00
Feb	21.00	44.60	3.10	83.50
Mar	21.00	45.40	5.20	79.50
Apr	21.00	46.70	7.60	75.50
May	21.00	51.40	10.60	76.00
Jun	21.00	57.20	14.00	74.50
Jul	21.00	61.90	15.80	75.00
Aug	21.00	62.60	15.40	77.50
Sep	21.00	58.60	13.20	79.50
Oct	21.00	53.90	10.00	83.00
Nov	21.00	48.00	6.00	84.00
Dec	21.00	46.40	4.20	85.50

Gc = Monthly moisture accumulation per area at an interface

Ma = Accumulated moisture content per area at an interface

Peak accumulated moisture content per area at interface (Ma) = 0.00000 Kg/m²

Annual moisture accumulation = 0.00000 Kg/m²

Project Information

Reference

Date 4 December 2023

Thermal Mass Details

	Thickness assessed (actual) (mm)	Density (kg/m ³)	Specific heat capacity (J/kgK)	Heat capacity (kJ/m ² K)
Ampatop Protecta	0.0 (-)	300.0	850.0	0.0
NaturHeld Wall 140	0.0 (140.0)	140.0	2100.0	0.0
Baumit RK38/39	0.0 (18.0)	1300.0	1000.0	0.0
Brick outer leaf	0.0 (105.0)	1700.0	840.0	0.0
Brick inner leaf	75.0 (105.0)	1700.0	840.0	107100000.0
Render, lime-sand	25.0 (25.0)	1600.0	1000.0	40000000.0
Total				147100000.0
kappa value				147.1000
Limiting condition:	100mm in			

Admittance : 4.37 W/m²K Decrement : 0.07 factor Decrement delay : -15.79 hours


Condensation Risk Analysis (no account taken of thermal bridges)

2 - Offices, shops and dwellings with low occupancy

Jan (worst)	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
21.0C 45.1%	21.0C 44.6%	21.0C 45.4%	21.0C 46.7%	21.0C 51.4%	21.0C 57.2%	21.0C 61.9%	21.0C 62.6%	21.0C 58.6%	21.0C 53.9%	21.0C 48.0%	21.0C 46.4%
3.1C 85.0%	3.1C 83.5%	5.2C 79.5%	7.6C 75.5%	10.6C 76.0%	14.0C 74.5%	15.8C 75.0%	15.4C 77.5%	13.2C 79.5%	10.0C 83.0%	6.0C 84.0%	4.2C 85.5%

	Interface Temp. °C	Dewpoint Temp. °C	Vapour Pressure (kPa)	Saturated V.P. (kPa)	Worst Cond. (g/m ²)	Peak Buildup (g/m ²)	Condensation
1 Outside surface resistance							
2 Ampatop Protecta	3.3	0.8	0.65	0.77			No
3 NaturHeld Wall 140	3.3	1.1	0.66	0.77			No
4 Baumit RK38/39	18.8	3.1	0.76	2.17			No
5 Brick outer leaf	18.9	3.5	0.79	2.18			No
6 Brick inner leaf	19.5	6.0	0.94	2.26			No
7 Render, lime-sand	20.3	8.2	1.09	2.39			No
8 Inside surface resistance	20.5	8.7	1.12	2.41			No

Worst case internal / external conditions for graph : 21.0°C @ 45.1%RH / 3.1°C @ 85.0%RH

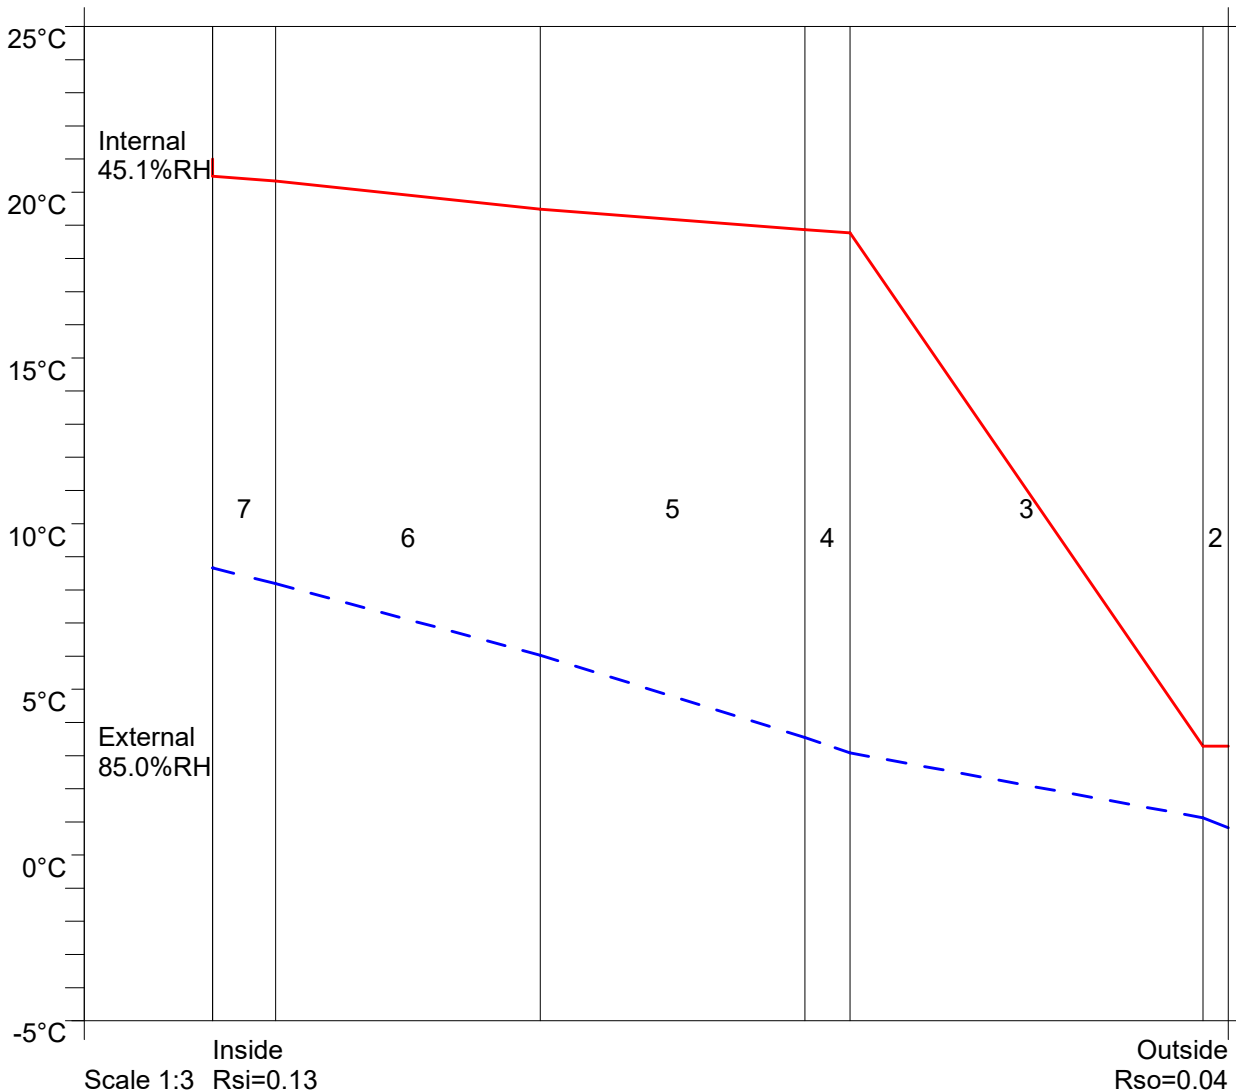

Condensation Risk Analysis (no account taken of thermal bridges)

2 - Offices, shops and dwellings with low occupancy

Jan (worst)	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
21.0C 45.1%	21.0C 44.6%	21.0C 45.4%	21.0C 46.7%	21.0C 51.4%	21.0C 57.2%	21.0C 61.9%	21.0C 62.6%	21.0C 58.6%	21.0C 53.9%	21.0C 48.0%	21.0C 46.4%
3.1C 85.0%	3.1C 83.5%	5.2C 79.5%	7.6C 75.5%	10.6C 76.0%	14.0C 74.5%	15.8C 75.0%	15.4C 77.5%	13.2C 79.5%	10.0C 83.0%	6.0C 84.0%	4.2C 85.5%

	Interface Temp. °C	Dewpoint Temp. °C	Vapour Pressure (kPa)	Saturated V.P. (kPa)	Worst Cond. (g/m ²)	Peak Buildup (g/m ²)	Condensation
1 Outside surface resistance	15.9	11.4	1.35	1.80			No
2 Ampatop Protecta	15.9	11.5	1.35	1.80			No
3 NaturHeld Wall 140	20.4	11.9	1.39	2.39			No
4 Baumit RK38/39	20.4	12.0	1.40	2.39			No
5 Brick outer leaf	20.6	12.7	1.46	2.42			No
6 Brick inner leaf	20.8	13.3	1.52	2.46			No
7 Render, lime-sand	20.8	13.4	1.54	2.46			No
8 Inside surface resistance							

Worst case internal / external conditions for graph : 21.0°C @ 61.9%RH / 15.8°C @ 75.0%RH

